




SALA DE MEDIDORES

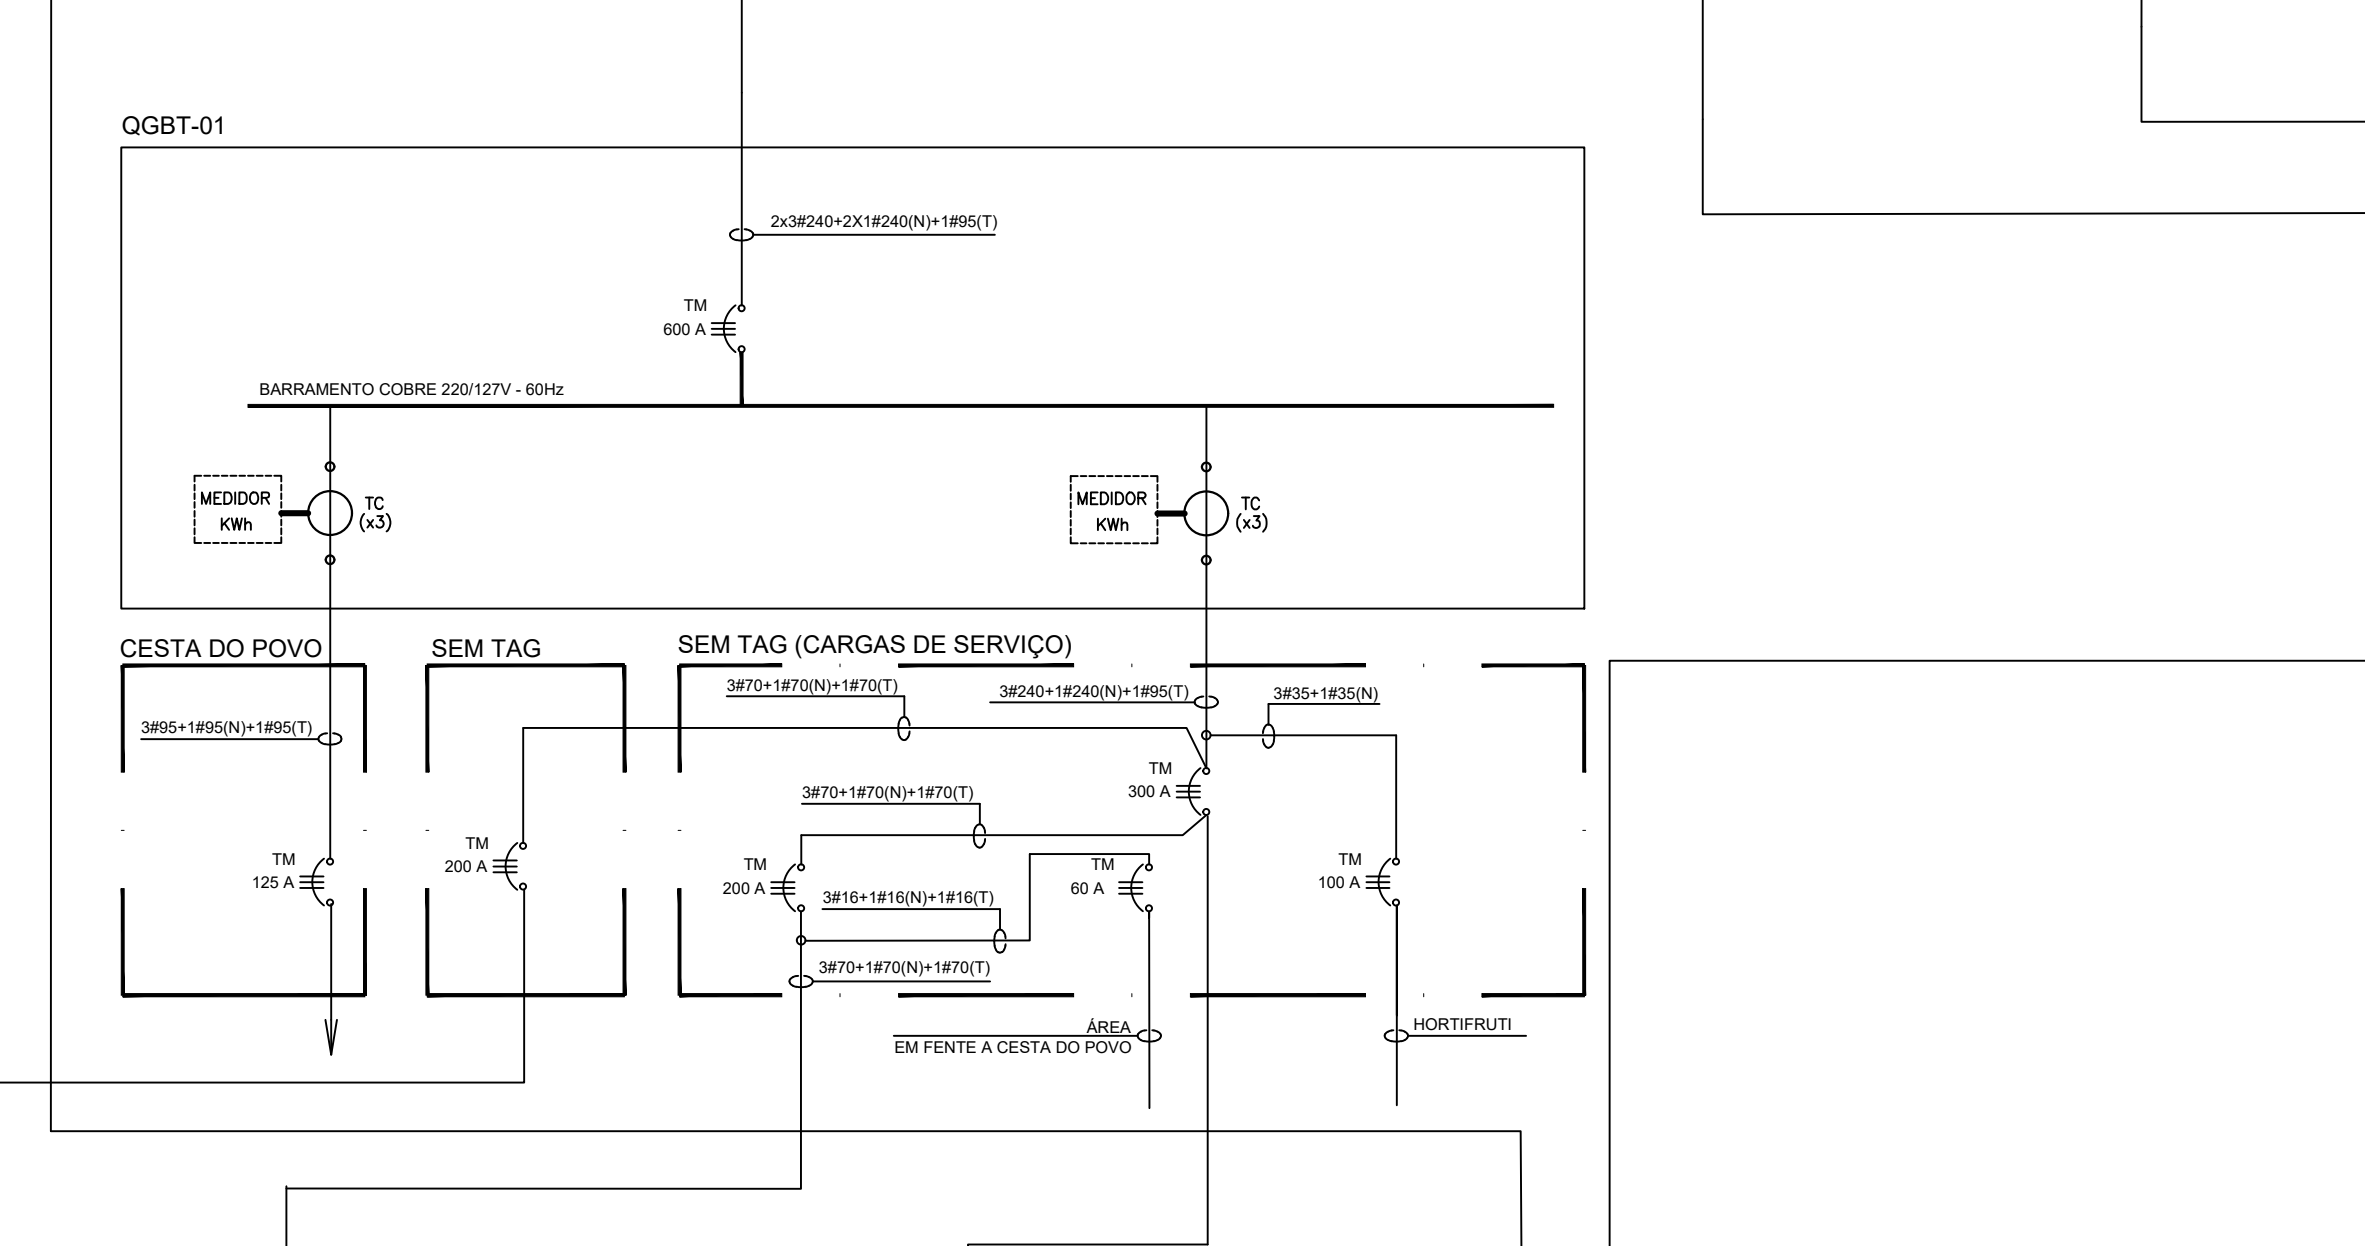

SALA DE PAINÉIS (TERREO)

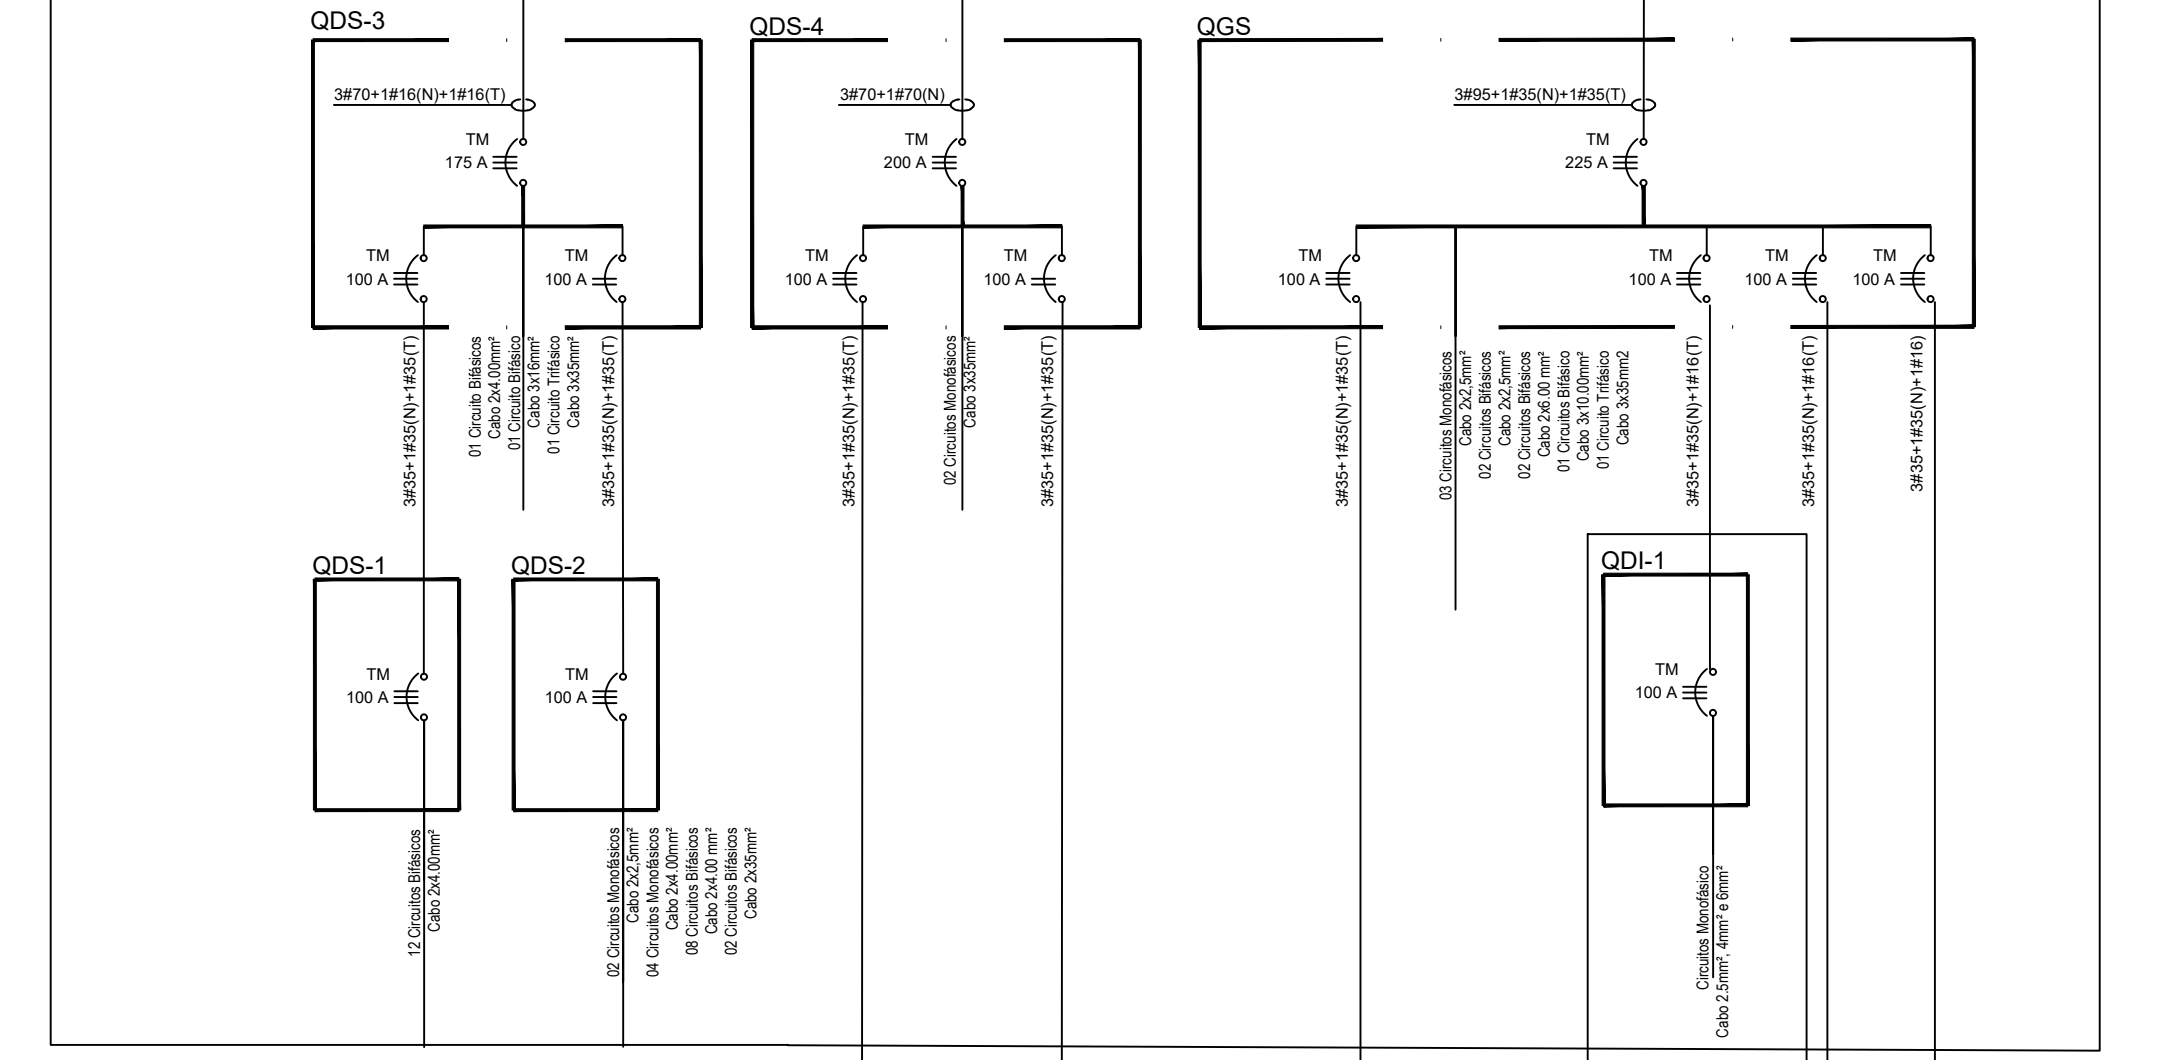


QGBT-02

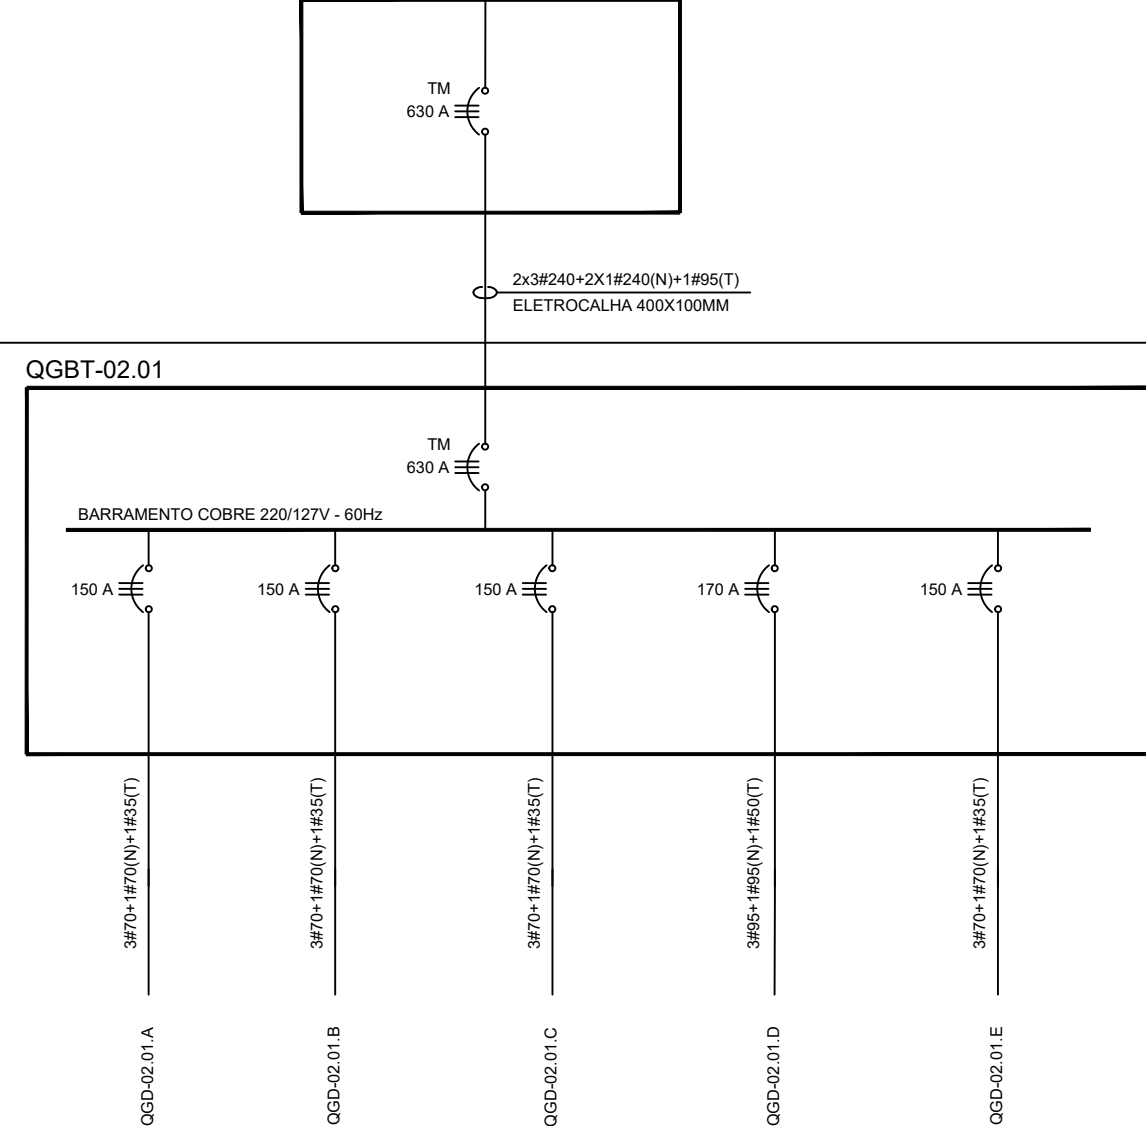

QGBT-02.01 (ALIMENTAM AS UNIDADES DO B1 AO B15)

CRC.	DESCRIÇÃO	QDT-BOX	TOTAL (W)	F.P.	TOTAL (VA)	QDT-DE	CORRENTE (A)	DISJ. (A)	CARGA (kW)
1	QDT-02.01.A	60-1F	37.500,00	1,00	37.500,00	3F	98,29	30150	30
2	QDT-02.01.B	60-1F	30.000,00	1,00	30.000,00	3F	78,74	24210	24
3	QDT-02.01.C	60-1F	44.700,00	1,00	44.700,00	3F	115,03	36150	36
4	QDT-02.01.D	60-1F	40.400,00	1,00	40.400,00	3F	103,13	32130	32
5	QDT-02.01.E	60-1F	42.500,00	1,00	42.500,00	3F	110,27	34530	34
TOTAL			195.100,00	1,00	195.100,00	200	505,03	157530	2040


QGBT-03

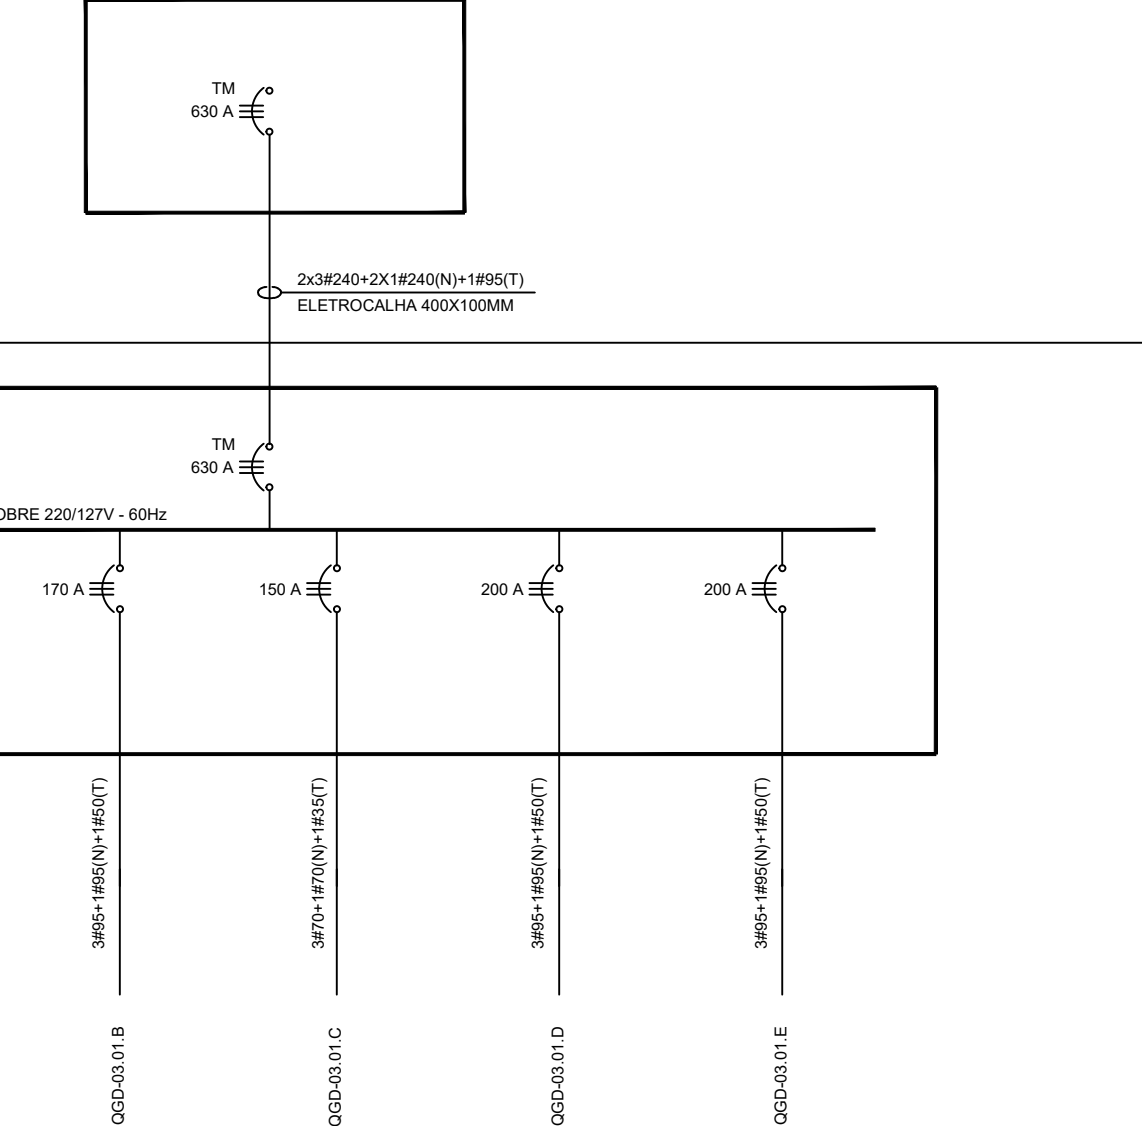

QGBT-03.01 (ALIMENTAM AS UNIDADES DO B16 AO B28)


CRC.	DESCRIÇÃO	QDT-BOX	TOTAL (W)	F.P.	TOTAL (VA)	QDT-DE	CORRENTE (A)	DISJ. (A)	CARGA (kW)
1	QDT-03.01.A	72-1F	51.000,00	1,00	51.000,00	3F	132,68	42150	42
2	QDT-03.01.B	72-1F	48.500,00	1,00	48.500,00	3F	124,13	39750	40
3	QDT-03.01.C	72-1F	46.000,00	1,00	46.000,00	3F	118,08	37350	38
4	QDT-03.01.D	72-1F	50.000,00	1,00	50.000,00	3F	127,97	40350	41
5	QDT-03.01.E	72-1F	54.400,00	1,00	54.400,00	3F	139,18	43710	44
TOTAL			250.100,00	1,00	250.100,00	200	641,96	203730	2640

QUADROS NOVOS

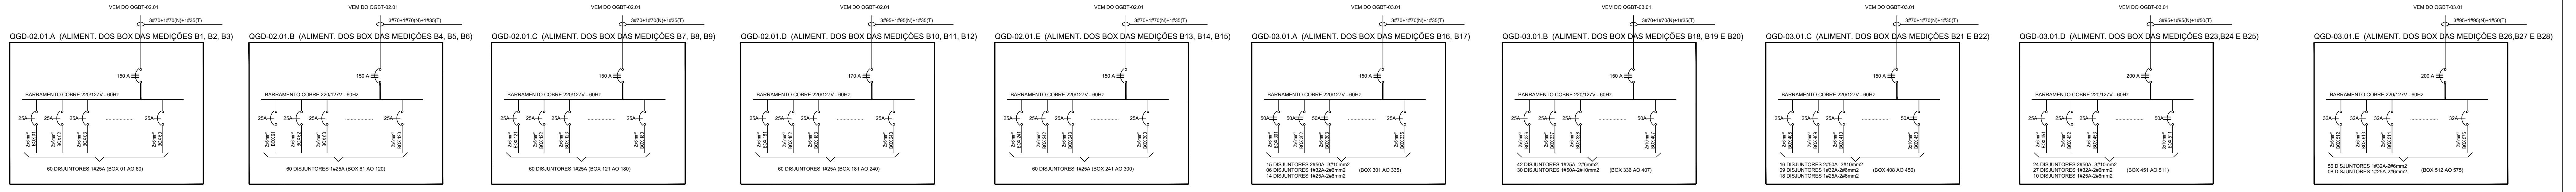

QUADROS NOVOS

QUADROS NOVOS

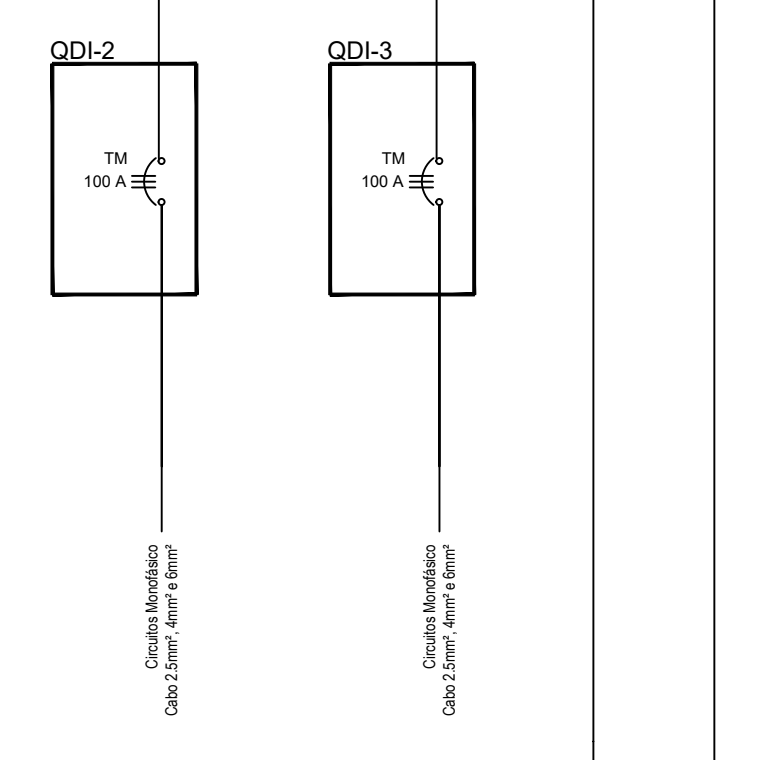

PAV SUPERIOR

